





Figure 2: Counting Zone Detection – Addressable

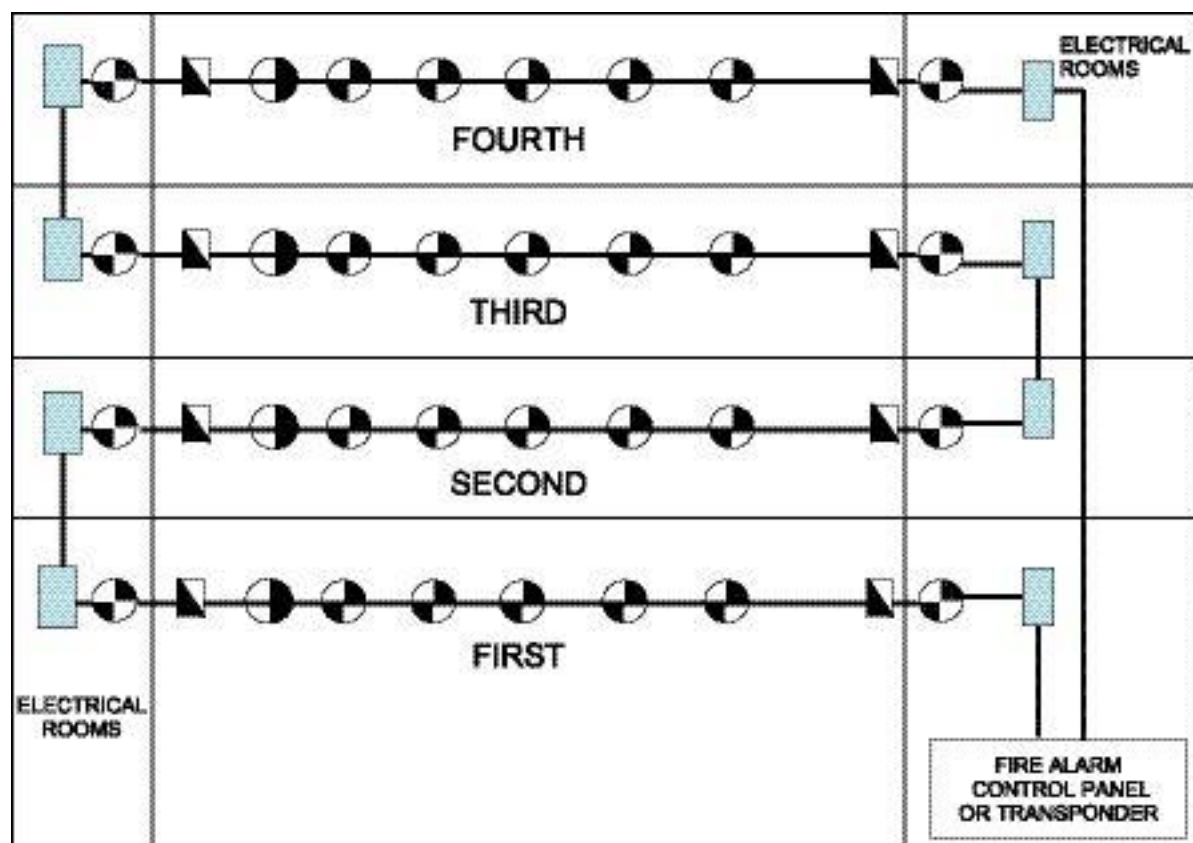


-  ADDRESSABLE MANUAL STATION
-  ADDRESSABLE SMOKE DETECTOR
-  ADDRESSABLE HEAT DETECTOR


-  FAULT ISOLATION MODULE
-  DATA COMMUNICATION LINK

## WIRING DIAGRAMS

**FIGURE 3A: WIRING DIAGRAM, 2W-B AND 2WT-B**

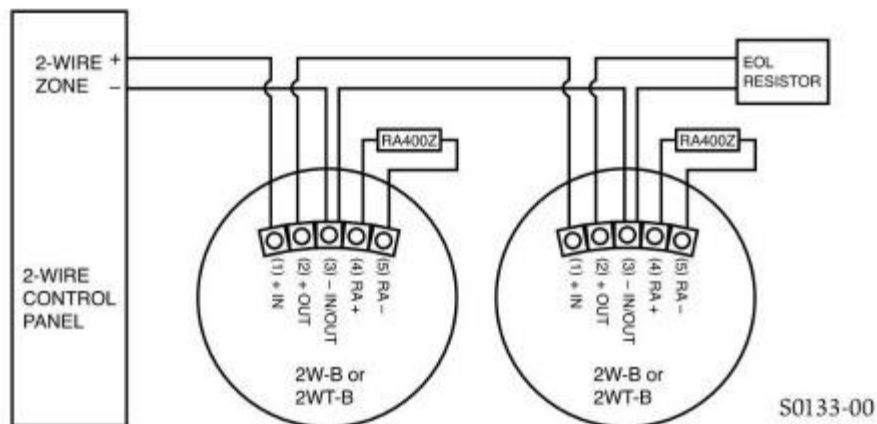

**FIGURE 3B: WIRING DIAGRAM, 4W-B AND 4WT-B**

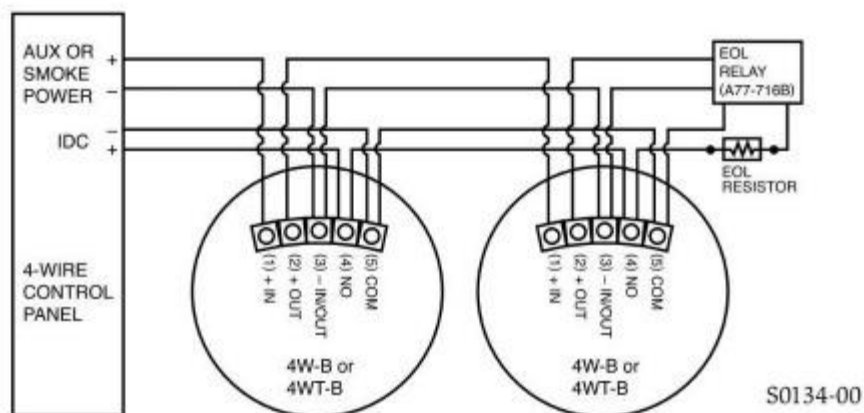

## 2-WIRE I<sup>3</sup> DETECTOR WIRED IN STYLE D CONFIGURATION:

Diagram by Systemsensor.com

